




NOT FOR CONSTRUCTION INFORMATION ONLY

535W Modules @ 15° Pitch
 Spacing - back to front = 4.50m
 front to front = 11.12m
 Inverters - 185KTL = 76
 Total no. of modules = 32832 modules
 Total no. of 3000KVA Tx = 5

Total Installed Capacity = 17.57 MWp
 Declared Net Capacity = 14.06 MW

Legend

- Security Fence
- Overhead Electrical Cables
- Underground Gas Main
- Underground Water Trunk Main
- DNO Access Route
- Site Boundary
- LV Cable Route(Cable Tray)
- Utility Easement
- Hardestanding Area
- PV Array
- LV Switch/transformer
- DNO Substation
- Customer Substation

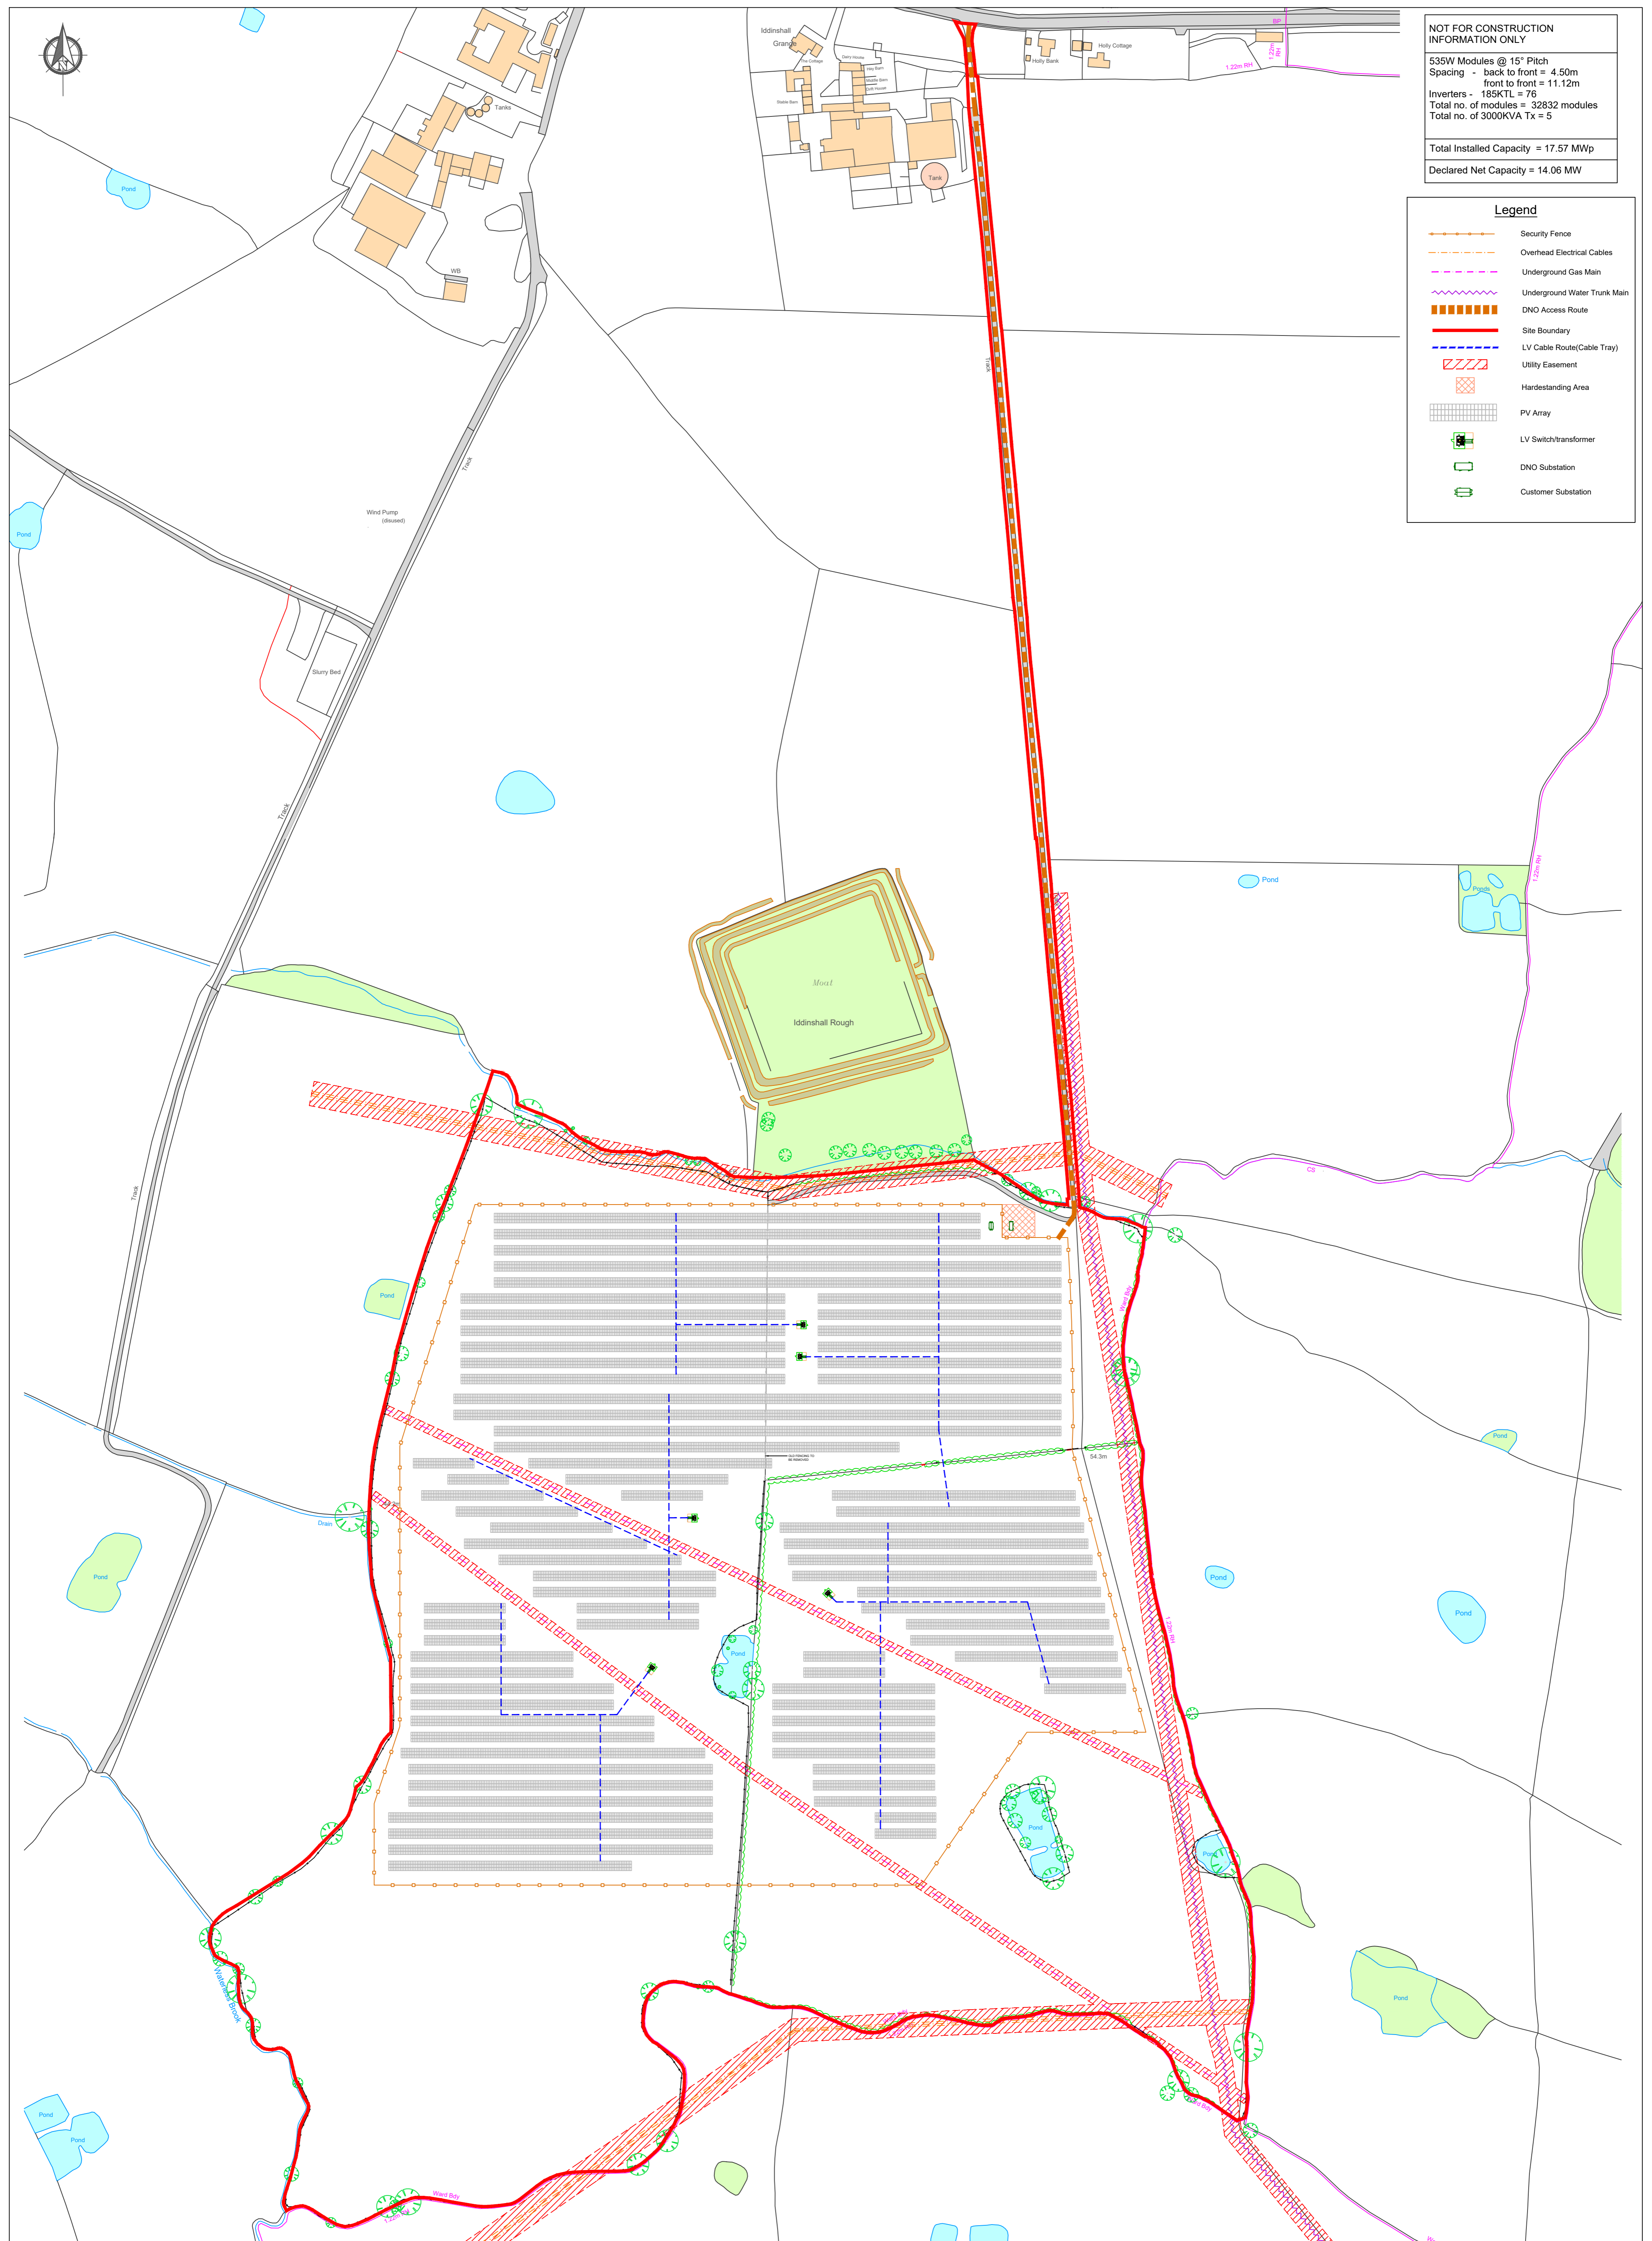

<p>Installer Details</p> <p>Anesco Ltd. The Green, Easter Park, Benyon Road, Reading, RG7 2PQ Tel: 0845 894 4444</p>	<p>Comments</p>	<p>SITE AREA: 91.91 Acres / 37.20ha GRID REFERENCE: SJ 53574 62560 Ordnance Survey. (c) Crown Copyright 2021. All rights reserved. Licence number 100022432</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Revision</th> <th>Description</th> <th>Revised By</th> <th>Approved By</th> <th>Date</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>Issued for comment</td> <td>JH</td> <td></td> <td>09/02/2021</td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>	Revision	Description	Revised By	Approved By	Date	A	Issued for comment	JH		09/02/2021																<p>Installation Address</p> <p>Iddinshall Rough, High Street, Clotton Hoofield, Clotton, CW6 0EQ</p>	<p>Project</p> <p>IDDENSHALL GRANGE</p> <p>Title</p> <p>SITE LAYOUT PLANNING</p> <p>Drawing No.</p> <p>C0002444_02_PL</p>	<p>Rev.</p> <p>A</p>
Revision	Description	Revised By	Approved By	Date																											
A	Issued for comment	JH		09/02/2021																											

